



Manufacturer of Industrial and
Environmental Solutions


800-443-7426
www.epgco.com

The Effect of Landfill Gas on Electric and Pneumatic Pumps and Controls

Chris Riddle
Application Engineer
EPG Companies Inc.

1

Landfill Gas Generation

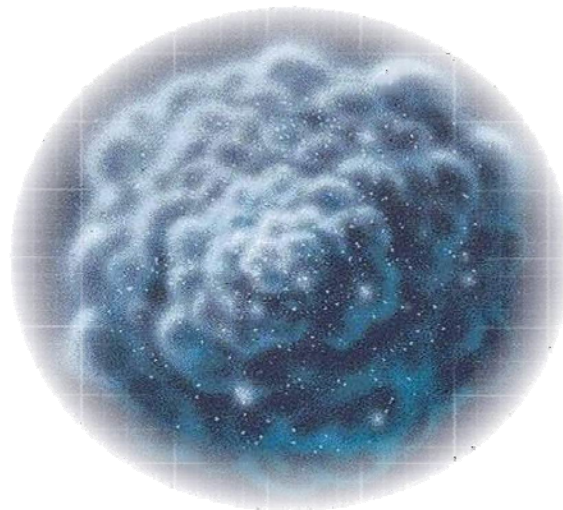

LFG is a product of
the decomposition
of waste.

1 pound of garbage
equals ~4 cubic feet
of gas

2

©2016 EPG Companies Inc.

Landfill Gas Generation



Here is the result of LFG if it is not accounted for.

3

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors

- We call it gas effect; you can call it a problem.
- It is a problem when you have pumps in a gas well, leachate collection sump (riser) or condensate sump and they also feel the positive pressure as gas is being created or negative pressure if a vacuum is being applied to collect the gas.
- Positive gas pressure will help push liquid into the pump while negative pressure is going to add to the system head loss that the pump must overcome.

4

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors

- Positive or negative gas pressure have an adverse effect on the accuracy of a submersible level sensor (transducer or transmitter).

5

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors

- For example: If the sensor is in a sump with 24" of liquid above the sensor, its display meter will read 24". If this same sump has 35" of positive gas pressure as well as 24" of liquid, then the meter will read 59".

Example of positive gas pressure.

6

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors


- If you have the same liquid level, but now the sump is under vacuum of 35” and you programmed the level meter to start at 55”, your pump will not start until the level reaches 90” of liquid depth and then shut off at 47” if the shut off set point is 12”.
- If the system switches from pressure to vacuum effect the pump will behave erratically, causing excessive wear and early failure.

Example of negative gas pressure (vacuum).

7

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors

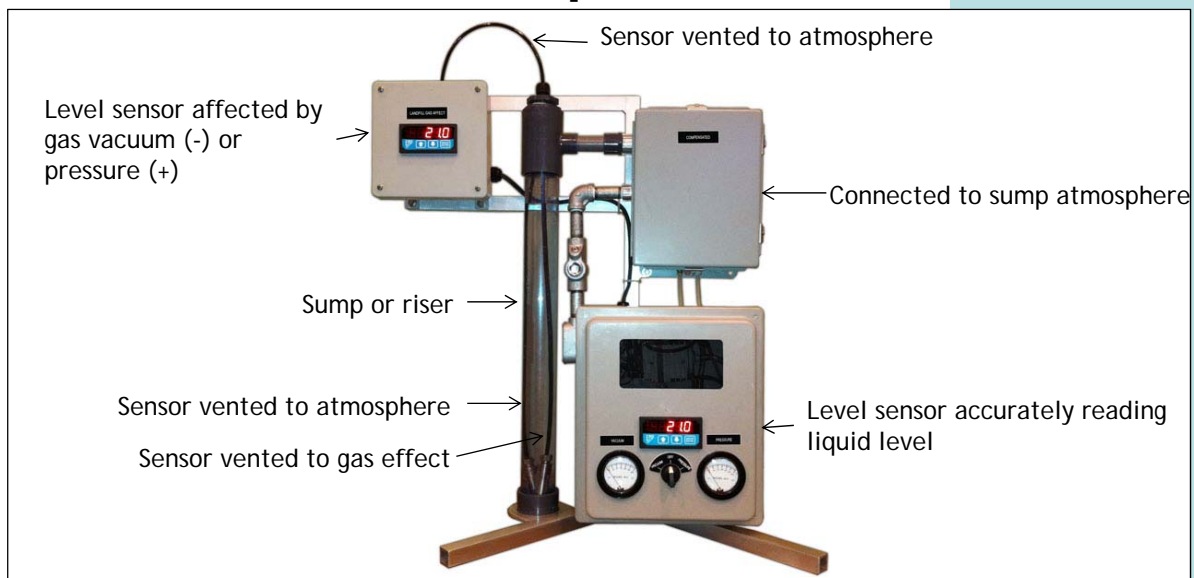


8

©2016 EPG Companies Inc.

Landfill Gas Effect – Pumps & Sensors

- Why should we care?
- What will it affect?
- What harm could it cause?

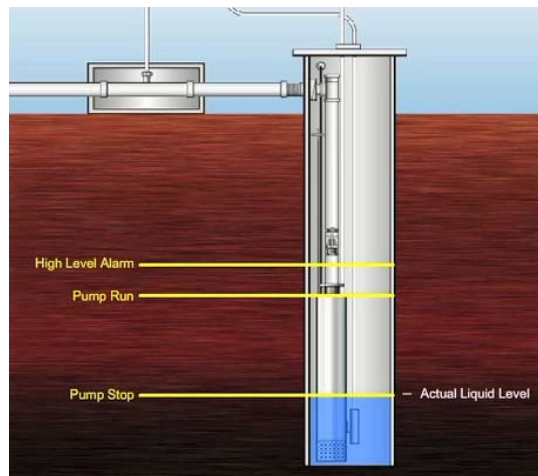

9

©2016 EPG Companies Inc.

Landfill Gas Effect on an Electric Pump

- Running an electric pump dry may cause:
 - Undue wear of pump and motor;
 - Overheating of the motor;
 - Introduction of air into discharge piping which may cause an air lock.

10

©2016 EPG Companies Inc.

Landfill Gas Effect on a Pneumatic Pump


- Running a Pneumatic Pump under pressure may cause:
 - Excess moisture in the exhaust gas line;
 - Introduction of gas into discharge piping which will cause the pump to stall due to an air lock.

- Operating a Pneumatic Pump under vacuum will cause an elevated liquid level before pumping can occur.

11

©2016 EPG Companies Inc.

Landfill Gas Effect on a Pneumatic Pump




Pneumatic Pump
Demonstration
Video

12

©2016 EPG Companies Inc.

Landfill Gas Effect on a Pneumatic Pump




Pneumatic Pump
Demonstration
Video

13

©2016 EPG Companies Inc.

Landfill Gas Effect on a Pneumatic Pump




Pneumatic Pump
Demonstration
Video

14

©2016 EPG Companies Inc.

Landfill Gas Effect on a Pneumatic Pump



Pneumatic Pump
Demonstration
Video

15

©2016 EPG Companies Inc.

Landfill Gas Effect

The How & Why of Breakout Junction Boxes

- Reason to use:
 - Prevent migration of landfill gas into the control panel
 - Simplify installation and maintenance
 - Increase overall safety of the pump and control system
 - Reduce operation problems
 - Reduce replacement costs
 - Increase life of sensors, controls and pumps

Follow the electrical code and use common sense when installing breakout junction boxes.

16

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box


- Standard junction boxes will not hold a pressure or vacuum over two to five inches of water column.
- To combat the gas effect you need a junction box designed and tested to withstand both pressure and vacuum applied.
- If the junction boxes leak when under a vacuum, it will contaminate the landfill gas. If under pressure, then they become a source of fugitive landfill gas.

17

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box

1. Bellows to seal backside of sensor
2. Desiccant dryer to keep sensor free of moisture
3. Four cover clamps for a gas tight seal
4. Clamp to secure sensor cable
5. Water-proof wire connectors to prevent corrosion
6. Gasketed hubs for liquid & gas tight seals

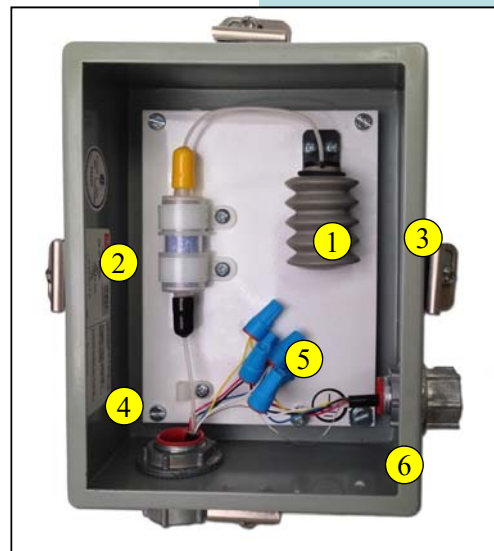

18

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box



Teflon Tape

Electrical Pipe Nipple

Myer's Hub

Water-proof wire connectors

19

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box


Note: When using screwed electrical fittings at a landfill, you should use Teflon® sealing tape on all of the thread joints to create a liquid and vapor tight seal. This tape will eliminate the conduit as a ground. This procedure requires you to pull a separate ground wire to maintain a good ground.



20

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box

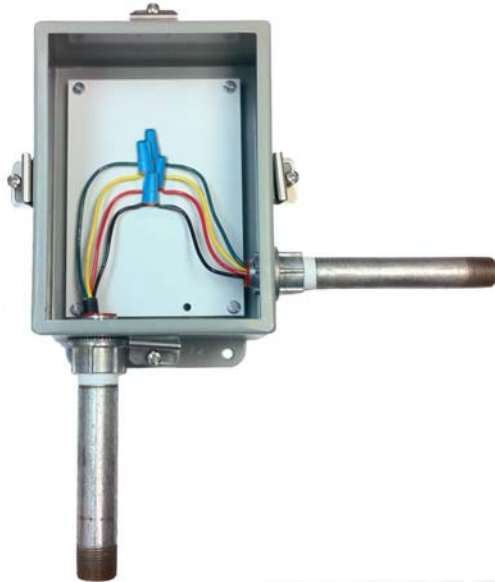

Breakout Box
assembled using:
Teflon Tape
Electrical Pipe
Nipples
Myer's Hubs
Water-proof wire
connectors

21

©2016 EPG Companies Inc.

Landfill Gas Effect – Junction Box

Label Explanation:

“Because this breakout junction box is protected by an intrinsically safe circuit, does not store energy and is not a source of ignition, the box can be mounted directly to the riser or sump which is under gas effect. This close connection is what makes it work.”



22

©2016 EPG Companies Inc.

Landfill Gas Effect – Control Panel

- The main entry points for landfill gas getting in to the control panel includes:
 - The absence of seal-offs;
 - Seal-offs that have not been potted;
 - Location of the control panel directly above or adjacent to the riser;
 - Other openings in the control panel not made liquid and vapor tight.

23

©2016 EPG Companies Inc.

Landfill Gas Effect – Control Panel



A site visit to a landfill resulted in this discovery:

A seal off which had not been potted.

24

©2016 EPG Companies Inc.

Landfill Gas Effect – Control Panel



25

©2016 EPG Companies Inc.

Landfill Gas Effect – Control Panel



26

©2016 EPG Companies Inc.

Landfill Gas Effect – Control Panel



27

©2016 EPG Companies Inc.

Landfill Gas Effect – Summary

- Gas can cause level sensors to provide inaccurate readings resulting in pumps running dry or violation of the 12” liquid on top of the liner rule.
- Pumps may stall due to gas getting in to the discharge piping and causing air locks.

28


©2016 EPG Companies Inc.

Landfill Gas Effect – Summary

- Breakout Junction Boxes capable of handling the pressure/vacuum should be used to ensure accurate level readings.
- Seal offs that are potted are a must to keep gas from getting into the control panel.

29

©2016 EPG Companies Inc.

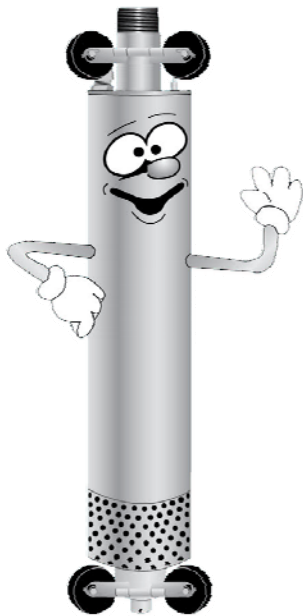

Questions?

30

©2016 EPG Companies Inc.